

## Benefits of Chlorine Dioxide – Industrial Cooling Water

### Product Information

Chlorine dioxide ( $\text{ClO}_2$ ) is uniquely suited for use as a biocide for industrial cooling water systems (both open recirculating and once-through). It is an oxidizing biocide that is effective against all macroorganisms, microorganisms (including Legionella), and algae. As an oxidizing biocide, organisms cannot develop immunity to it. There are several major advantages involved in the use of  $\text{ClO}_2$ :

- It is much more effective against biofilms than traditional biocides used today.
- It is highly effective against Legionella.
- It produces lower system corrosion rates.
- It is compatible with other cooling water treatment chemistries.
- It is a “green” biocide.

### General Description

- $\text{ClO}_2$  is a greenish-yellow gas with an odor similar to chlorine ( $\text{Cl}_2$ ).
- Its solubility in water is approximately ten times greater than that of  $\text{Cl}_2$ .
- $\text{ClO}_2$  is generated and fed as an aqueous solution.
- It is effective across a wide pH range (5.0-10.0).


### Elimination of Biofilms

Biofilms cause numerous problems in cooling water systems. These include:

- Loss of heat transfer – Biofilm is the most insulating compound found in cooling water systems, much more so than mineral scales. A few millimeters can cause loss of 20+% of heat exchange.
- Increased corrosion rates.
  - Differential cell corrosion
  - Pitting due to metabolic by-products of acid producing anaerobic bacteria (APBs).
- Inability of corrosion inhibitors to contact and passivate metal surfaces. Provide the environment for the growth of Legionella bacteria.
- Increase scaling potential. The negative surface charge of biofilms tends to concentrate scaling ions (e.g., Ca, Mg, etc.), such that they exceed solubility in the local area and precipitate.

Chlorine dioxide is much more effective for removal of biofilm than other alternatives for the reasons shown in the following figures. Once eliminated, the biofilms take up to several days to re-establish themselves. Thus, a system treated with  $\text{ClO}_2$  will typically exhibit improved heat transfer and lower corrosion rates (typically 25-50% lower).


**Figure 1:** Biofilms have a negative surface charge. Chlorine and bromine hydrolyze to negatively charged hypochlorous acid or hypobromous acid in water, which are then repelled by the biofilm surface. Thus, the neutral  $\text{ClO}_2$  molecule will penetrate the sessile bacteria (biomass), while the other compounds are repelled by the negative surface charge.

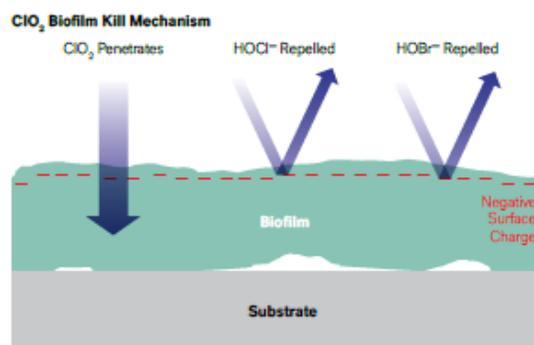




# Benefits of Chlorine Dioxide – Industrial Cooling Water

**Figure 2:** 50-70% of the  $\text{ClO}_2$  reverts to chlorite ( $\text{ClO}_2^-$ ) after reacting in the biofilm.

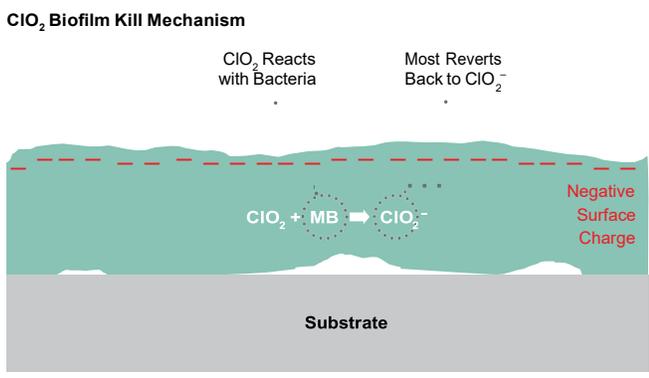

**Figure 3:** Under the aerobic biofilm, anaerobic bacteria will grow. Acid producing anaerobic bacteria (APBs) produce acid as a metabolic by-product. When the chlorite ion contacts the acid, it produces  $\text{ClO}_2$ , by the chlorite/acid reaction described on p. 3.

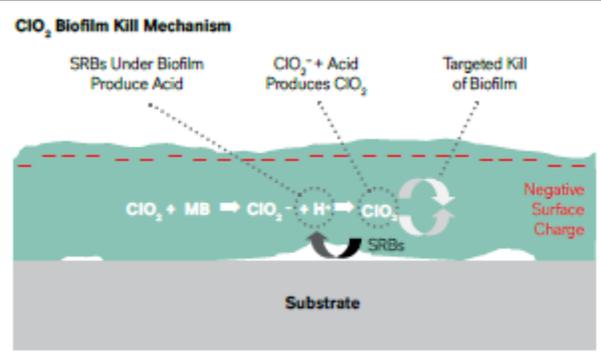

Counterflow cooling towers have a weak point with their high efficiency fill. This serves as an ideal bacterial growth location. It is wetted, saturated with oxygen, and has a high food loading through atmospheric scrubbing and any process leaks that are present.  $\text{ClO}_2$  is the only biocide that has shown the ability to clean fouled, high efficiency fill online.



Research has shown that Legionella requires higher life forms (i.e., amoeba, flagellates, etc.) as a host for reproduction. Thus, they flourish in a bacterial biofilm, where these organisms are found. By eliminating biofilms from cooling systems, the potential for Legionella can be virtually eliminated. The Association of Water Technologies has published recommended treatment protocols for Legionella for numerous biocides, including chlorine, bleach, bromine, and nonoxidizing biocides. While all of the other programs feature “hyper” dosage treatment levels, the recommended program using  $\text{ClO}_2$  is the same as our normal intermittent cooling water treatment program. This is a clear indicator that  $\text{ClO}_2$  is highly effective at controlling Legionella without using extraordinary measures.



# Benefits of Chlorine Dioxide – Industrial Cooling Water

## Lower System Corrosion Rates

As mentioned earlier, the largest influence on system corrosion rates are biofilms. They increase corrosion by several methods:

- The “patchy” or nonuniform coverage of metal surfaces establishes differential oxygen cell corrosion.
- APB species that are present under the aerobic biofilm are the primary source of pitting corrosion.
- Biofilms prevent corrosion inhibitors from successfully contacting and passivating system metal surfaces.

In addition, other oxidizing biocides typically encountered (e.g., chlorine, bleach, bromine) are fed continuously. They are also stronger oxidizers. This results in increased corrosion from their continuous presence. To make matters worse, when process leaks occur, feed rates of these compounds are normally increased substantially in an attempt to maintain a residual sufficient to control microbial growth. This further increases corrosion.

In contrast, ClO<sub>2</sub> is a weaker oxidant that, although counterintuitive, is an advantage:

- It does not react with organics (such as hydrocarbons), and, thus, results in little increase in dosage during process leaks.
- It is fed intermittently, typically only 2-4 hour per day, and, thus, is in the system only a small percentage of the total time.
- As a weaker oxidant, it is less corrosive.

The net result is that by using ClO<sub>2</sub> (a weaker oxidant), eliminating biofilm while feeding intermittently, and providing clean surfaces for corrosion inhibitors to effectively passivate, corrosion rates are significantly lower.

## Compatible with Other Cooling Water Chemicals

Industrial cooling water treatment programs typically employ some combination of orthophosphate, polyphosphate, organic phosphates, tolyltriazole (TTA), scale inhibitors, and dispersants. Various researchers have performed work that shows ClO<sub>2</sub> will have no detrimental effect on these chemistries. This is logically consistent with the fact that as a weaker oxidant, ClO<sub>2</sub> would be expected to have no effect on chemistries that are routinely used with chlorine and bromine, which are stronger oxidants.

As an added benefit, chlorine and bleach are known to react with TTA, which is used as a copper alloy corrosion inhibitor in most cooling water treatment programs. ClO<sub>2</sub> does not react with it and can result in a measurable decrease in the required TTA dosage.



## Environmental

As a weaker oxidizing compound, ClO<sub>2</sub> will not form chlorinated organics (as will chlorine, bleach, and bromine). This means that in the presence of hydrocarbons or other organic compounds, no objectionable organic compounds will be formed (such as chloroform — a carcinogen). Thus, there will be no potential discharge water permit violations due to the microbiological control program.

By eliminating the need for nonoxidizing compounds, the potential release of these long half-life poisons is prevented. As well, the potential of these poisons affecting the biological waste water treatment plant via the cooling tower blowdown is prevented.

The ultimate decay product of ClO<sub>2</sub> is chloride, which is totally unobjectionable at the feed rates used (<5 ppm).

All of these factors combine to make ClO<sub>2</sub> a “green” biocide.



# Benefits of Chlorine Dioxide – Industrial Cooling Water

## Methods of ClO<sub>2</sub> Production

Chlorine dioxide must be produced at the point of use.

Physical characteristics prevent its being produced offsite and transported. There are three potential methods of producing ClO<sub>2</sub> for industrial scale applications. The basic precursor required for all of them is sodium chlorite.

### Chlorite + Hydrochloric Acid



### Chlorite + Chlorine Gas



### Chlorite + Sodium Hypochlorite + Hydrochloric Acid



The chlorite/acid method produces a maximum of only 80% conversion of chlorite to ClO<sub>2</sub>; thus, it is more expensive to produce ClO<sub>2</sub> with this process. For this reason, it is typically used for small applications only. The preferred methods are either the chlorite/chlorine gas or chlorite/bleach/acid generation methods. Our ClO<sub>2</sub> generators are capable of achieving conversions of 95+% of chlorite to ClO<sub>2</sub>.

## Application to Cooling Water Systems

As a gas in aqueous solution, the preferred injection location is the suction of the circulating water pumps in the cooling system. Upon return to the cooling tower, most of it will be stripped from the water. To what degree it is removed depends largely upon the type of fill the cooling tower has. High efficiency fill allows more of the ClO<sub>2</sub> to return to the tower basin (up to ~50%), while splash bar type fill results in higher losses (~90%).

**Health and Safety Information:** Appropriate literature has been assembled which provides information concerning the health and safety precautions that must be observed when handling the International Dioxide, Inc. products mentioned in this publication. For materials mentioned which are not International Dioxide, Inc. products, appropriate industrial hygiene and other safety precautions recommended by their manufacturers should be followed. Before working with any of these products, you must read and become familiar with the available information on their hazards, proper use, and handling. This cannot be overemphasized. Information is available in several forms, e.g., safety data sheets and product labels. Consult your International Dioxide representative or contact the International Dioxide, Inc. Regulatory Affairs Representative.

The manner in which you use and the purpose to which you put and utilize our products, technical assistance and information (whether verbal, written or by way of production evaluations), including any suggested formulations and recommendations are beyond our control. Therefore, it is imperative that you test our products, technical assistance and information to determine to your own satisfaction whether they are suitable for your intended uses and applications. This application-specific analysis must at least include testing to determine suitability from a technical as well as health, safety, and environmental standpoint. Such testing has not necessarily been done by us. Unless we otherwise agree in writing, all products are sold strictly pursuant to the terms of our standard conditions of sale. All information and technical assistance is given without warranty or guarantee and is subject to change without notice. It is expressly understood and agreed that you assume and hereby expressly release us from all liability, in tort, contract or otherwise, incurred in connection with the use of our products, technical assistance, and information. Any statement or recommendation not contained herein is unauthorized and shall not bind us. Nothing herein shall be construed as a recommendation to use any product in conflict with patents covering any material or its use. No license is implied or in fact granted under the claims of any patent.

ERCOPure™ and any associated logos are trademarks or copyrights of Superior Plus LP. International Dioxide and the International Dioxide logo are trademarks of International Dioxide, Inc. All trademarks are effective in many countries worldwide.

Note: The information contained in this publication is current as of July 2019. Please contact International Dioxide, Inc. to determine if this publication has been revised.

Cooling water systems treated with ClO<sub>2</sub> will require the following steps be taken to transition from other microbiological control programs.

- **Establish Baseline** performance. Monitor the existing program for a minimum of 30 days to establish microbiological growth rates, corrosion rates, etc.
- An initial **Cleanup Phase**
  - Usually 3-7 days in duration.
  - Feed at approximately 0.5-0.7 ppm residual at the circulating pump discharge for 8 hours per day.
- An **Optimization Phase** – Dosages and feed duration are adjusted based on microbiological testing to obtain minimum chemical consumption.
- **Intermittent Maintenance** dosage application. Please contact International Dioxide for dosage and cost calculations, as well as additional information on this product and its other uses.

## Information Available

International Dioxide, a division of ERCO Worldwide, has specialized in chlorine dioxide technologies for over 70 years, and is a leading supplier of sodium chlorite solutions and generator technology for a wide variety of markets.

For additional information please contact the sales office at 1-800-477-6071 or online at [idiclo2.com](http://idiclo2.com)



**International Dioxide™**

AN ERCO WORLDWIDE COMPANY  
**International Dioxide**

40 Whitecap Drive  
North Kingstown, RI 02852  
1-800-477-6071

**idiclo2.com**

International Dioxide, Inc.  
EE 000XX



**RESPONSIBLE CARE®**  
OUR COMMITMENT TO SUSTAINABILITY



# Benefits of Chlorine Dioxide – Industrial Cooling Water